


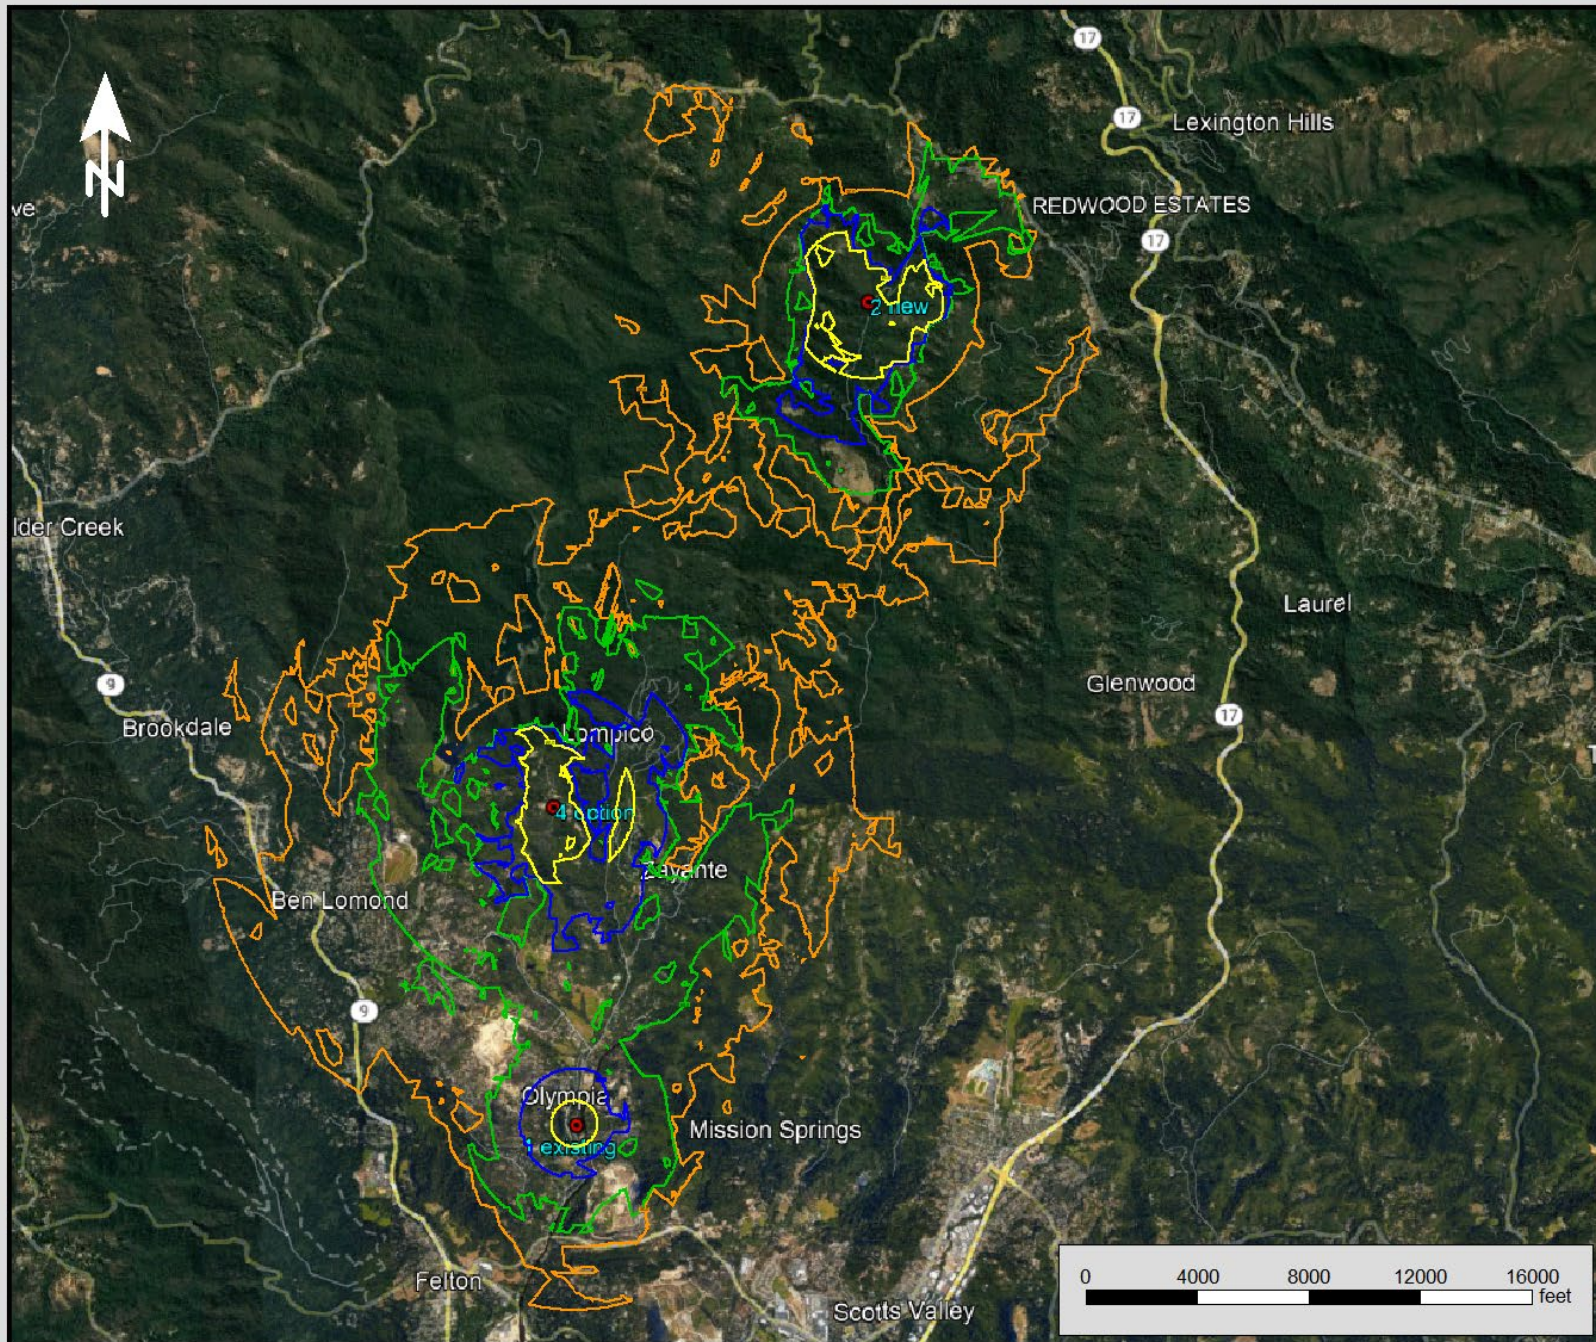

Zyante Fire Protection District

Acoustic Analysis

ISO9613-2

MAP 004

Lmax
in dB(C)

	= 80
	= 70
	= 60
	= 50

